


The following is a suggested configuration for meter bases for overhead and underground meters in residential and commercial applications. OGE Energy Corp., its subsidiaries and affiliates, disclaim any and all liability for the construction or maintenance practices relating to such suggested configuration. Each individual, company, or entity engaging the work associated with this configuration bears full responsibility for its, his, or her own occupational training, and compliance with all applicable local, state, and national laws and regulations. The configuration is not intended to replace the training, know-how, or instruction that may be needed for safe construction or maintenance.

U763.6

UNDERGROUND STANDARD
FIRST ISSUE - JUN 2020

**This Application MUST Meet All
NEC & AHJ Rules and Regulations**

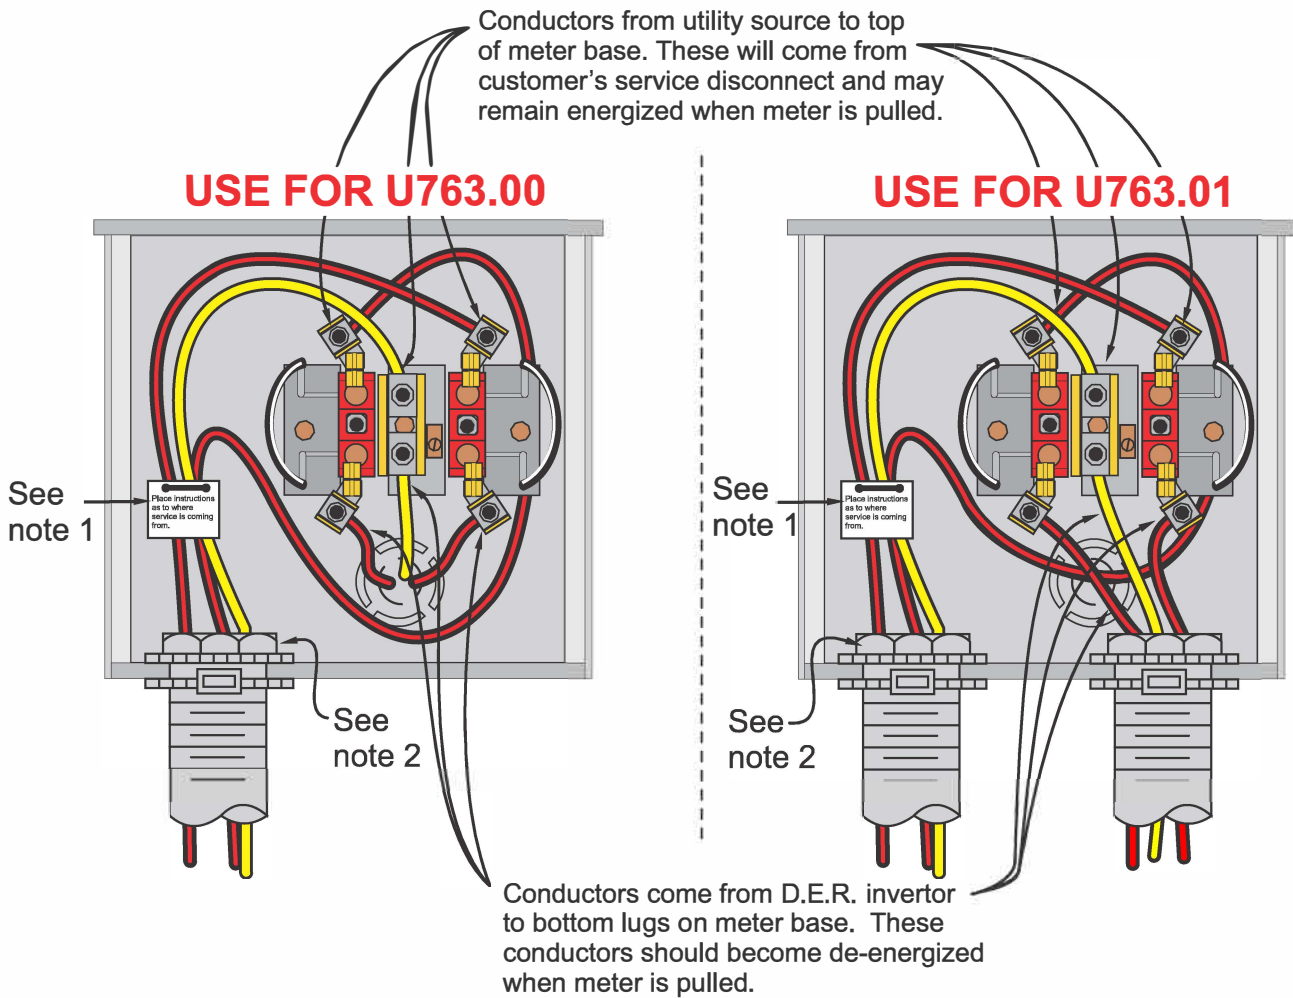

Notes:

1. Place identifying tag on service conductors with information stating the production meter is fed from the NET meter. Refer to U16.
2. Plastic bushing required for conduit to protect cable
3. Meter Base, **281065**, (underground application), furnished by OG&E, installed by consumer.
4. Service lateral raceway to be furnished and installed by consumer.

PRODUCTION METER CONNECTION DIAGRAM

SINGLE PHASE 200-AMPERES MAXIMUM