
SUPERSEDES JUL 2018 ISSUE

Oklahoma Gas and Electric Company ©

DISTRIBUTION STANDARD Version G - JUN 2020

D727

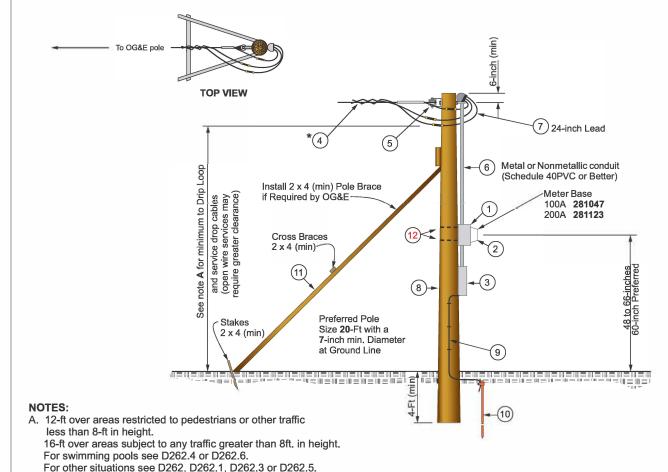

B. Use 1/2" thru bolts on top and bottom to mount meter base.

*Refusal to attach service to inadequate structure is determined by OG&E installer based on but not limited to pole size and type, bracing, and attachment height.

<u> </u>					
ITEM NO.	DESCRIPTION	FURNISHED BY		INSTALLED BY	
		O.G.& E.	CONSUMER	O.G.& E.	CONSUMER
1	METER BASE	Х			Х
2	METER	Х		Х	
3	SERVICE EQUIPMENT		х		Х
4	*SERVICE DROP	Х		Х	
5	SERVICE DROP BRACKET	Х			Х
6	SERVICE RACEWAY		х		Х
7	SERVICE ENTRANCE CONDUCTOR		х		Х
8	CONSTRUCTION POLE		х		Х
9	GROUNDING ELECTRODE CONDUCTOR		х		Х
10	GROUNDING ELECTRODE		х		Х
11	POLE BRACES		х		Х
12	1/2" Mounting bolts See note B		х		Х

TEMPORARY SERVICE 3 WIRE SINGLE-PHASE 240/120-VOLTS