
U763.01

UNDERGROUND STANDARD Version A - AUG 2021

OKLAHOMA ONLY

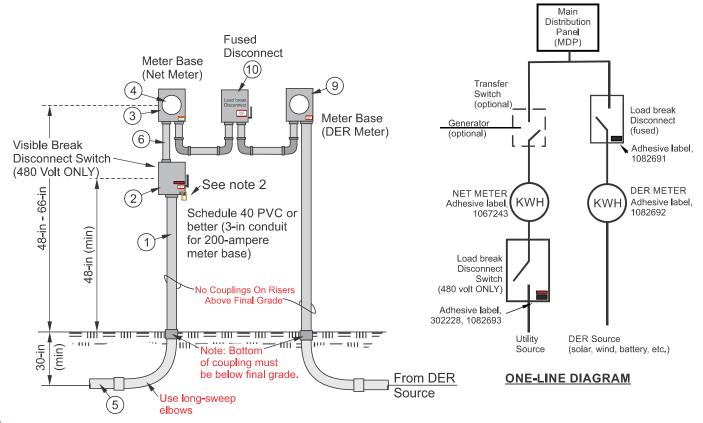

ITEM NO.	DESCRIPTION	FURN I SHED BY		INSTALLED BY	
		OG&E	CONSUMER	OG&E	CONSUMER
1	Service Lateral Raceway		x		x
2	Load-Break Disconnect (480 Volt Only)		х		х
3	Meter Base	Х			х
4	Self-Contained Meter, NET	Х		Х	
5	Service Lateral	Х		Х	
6	Service Raceway		х		x
*7	Service Equipment		х		х
*8	Grounding Electrode & Grounding Electrode Conductor		х		Х
9	Self-Contained Meter, DER	Х		Х	
10	Fused Disconnect		х		×

^{*} Not Shown

Notes:

- 1. Must comply with OG&E DER Interconnection Standards.
- 2. OG&E to secure load-break disconnect box with series 1 lock (stk#301236).
- 3. OG&E equipment is to be installed on outside surface of structure and is not to be recessed.
- 4. Refer to U16 for proper identification and marking.
- 5. Refer to U760 & U760.1 for Metering Guidelines.
- 6. Testing and certification with completed application must be received.
- 7. Visible Break Isolation Device must be within 10' of main or DER meter.
- 8. Meters are to be bi-directional
- 9. OG&E equipment not to be used for customer grounding.

DISTRIBUTED ENERGY RESOURCE (DER) METER INSTALLATION FOR SELF-CONTAINED METERS

120/240 & 120/208 400-AMPERES MAXIMUM, 277/480-VOLTS 200-AMPERES MAXIMUM DER NOT CONNECTED THOUGH CUSTOMER MDP

SUPERSEDES AUG 2019 ISSUE APPROVED Signatures on File