
SUPERSEDES JUN 2021 ISSUE

APPROVED Signatures on File

U773.7

UNDERGROUND STANDARD Version I - APR 2023

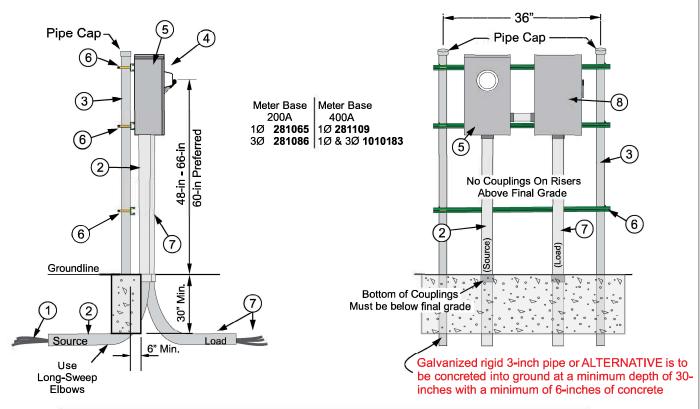

ITEM Number	DESCRIPTION	FURNISHED BY		INSTALLED BY	
		O.G.&E.	CONSUMER	O.G.&E.	CONSUMER
1	Service Lateral	Х		Х	
‡ 2	Service Lateral Raceway & 90° Bend		×		Х
3	3-inch Galvanized Rigid Pipe OR Refer to Notes for ALT *6-9 (set in concrete)		х		х
4	Meter	Х		Х	
5	Meter Base	Х	11		Х
6	1 5/8-inch Kindorf and Clamps		Х		Х
7	Conduit and wire		Х		х
8	Fused/Breaker Disconnect Switch		X		Х
*9	Grounding Electrode & Grounding Electrode Conductor		х		х

^{*} Not shown | # 3" Schedule 40

Notes

- 1. Place caps on top of pipes to keep moisture from inside of pipe to prevent deterioration.
- When meter cannot be mounted on a building, place two pipes 36-inches apart with 1-5/8-inch Kindorf between pipes to attach equipment.
- 3. Refer to U16 for proper identification and marking.
- 4. In order for the meter to be accessible for operation and maintenance, a minimum of 5 feet clearance from all obstructions must be maintained in front of the meter.
- 5. OG&E equipment not to be used for customer grounding.
- 6. All metal may be pipe or tubing: round, square, or rectangle.
- 7. Uprights must be minimum of 11ga (1/8-inch) and 3-inch diameter (Round), 3"x 3" (Square), or 3" x 4" (Rectangle)
- 8. Cross-members must be minimum of 14ga (5/64-inch).
- 9. If not galvanized, must be painted with an effective anti-corrosive and rust preventive coating.

METER INSTALLATION

FOR SELF-CONTAINED SINGLE OR THREE PHASE METER 240/120, 240Δ/120, OR 208Y/120 VOLTS 400-AMPERES MAXIMUM